

## B1303-F6

### Description:


Analyzed resistance of 50-sample spring contact probes under a cycle life totaling 500,000 cycles employing a "4-wire" Kelvin test set-up @ ambient temperature.

### Tested under the following conditions:

Cycle Life- 500,000 Cycles  
Test Date- August- 2002  
Tester- Rich  
Equipment- Cycle Tester # 4

### 50 Sample Probes: (m Ohms)

**B1303-F6 500K**  
**Average Resistance**  
29.82 mOhms @ Amb.

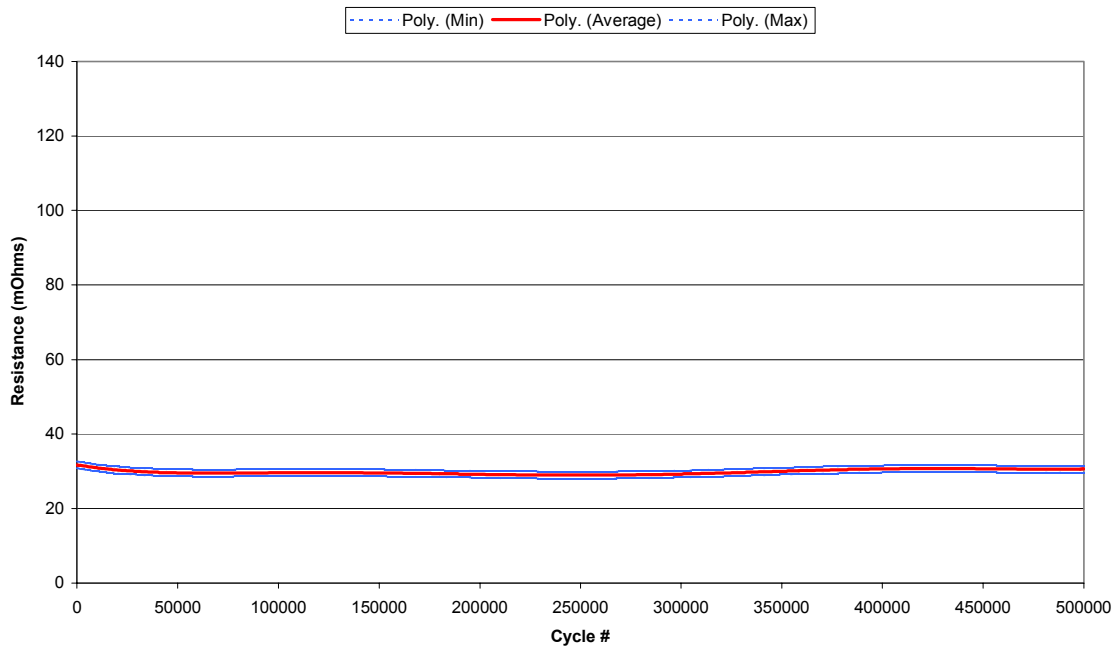

### **Summary:**

- Under a cycle program totaling 500,000 life cycles, the 50 sample probes have an average resistance of 29.82m Ohms throughout entire 500,000 life cycles. Resistance will slowly increase as cycle life increases.



**RIKA DENSHI AMERICA, INC.**

112 Frank Mossberg Drive, Attleboro, MA 02703 USA

Tel: (508) 226-2080 / Toll Free: (877) 902-TEST / Fax: (508) 226-2980

Email: [mktg@testprobe.com](mailto:mktg@testprobe.com)