

B1835-A1


Description:

Analyzed resistance of 35-sample spring contact probes under a cycle life totaling 500,000 cycles employing a "4-wire" Kelvin test set-up.

Tested under the following conditions:

Cycle Life- 500,000 Cycles
Test Date- October 2004
Tester- L.Sarcione
Equipment- Tester #2

35 Sample Probes: (m Ohms)

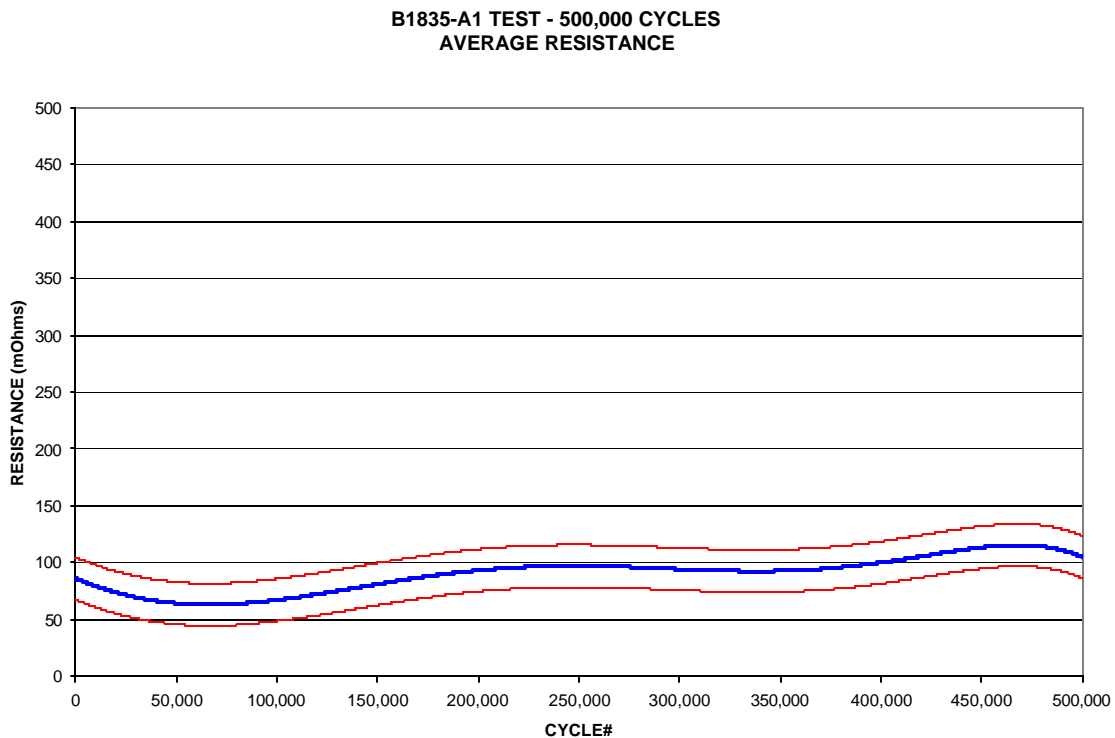

Summary:

- ✍ Under a cycle program totaling 500,000 life cycles, the 35 sample probes have an average resistance of 90 mOhms throughout entire 500,000 life cycles. Resistance will slowly increase as cycle life increases.



RIKA DENSHI AMERICA, INC.

112 Frank Mossberg Drive, Attleboro, MA 02703 USA

Tel: (508) 226-2080 / Toll Free: (877) 902-TEST / Fax: (508) 226-2980

Email: mktg@testprobe.com